

A simple 3 step
drain process
to winterize your system




State of the Art
in Watering
Since
1957

For systems with a Double Check backflow prevention device

Step 1: Shut the water to the system off




Your *shut off* is located: _____

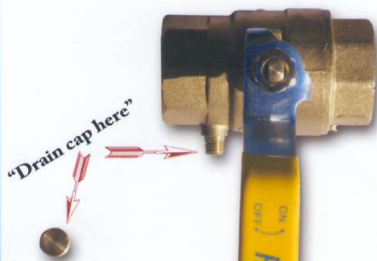


Turn the ball valve handle to a perpendicular position [1/4 turn]. The cap on the drain port must also be opened to allow the water to drain out. It is recommended to do this last after step 2 and 3 so as not to drip water anywhere.

Step 2: Winterize the double check [two things to do]


A] Turn the two blue handled ball valves to a 45 degree angle position.

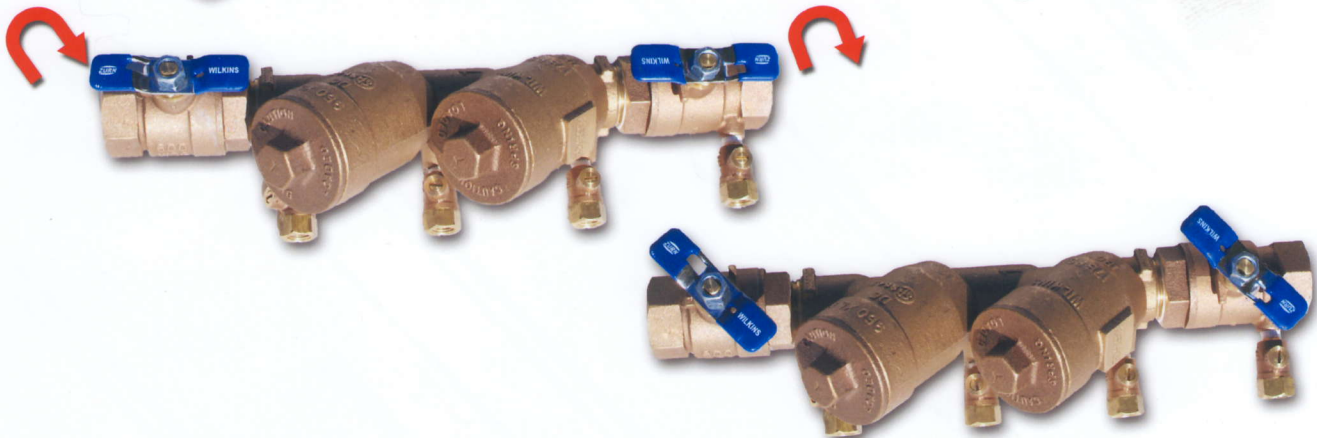


B] Open the four test cocks 1/4 turn using a standard screwdriver

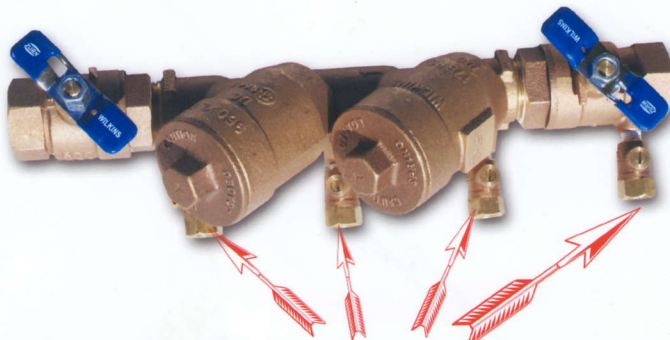


"Four test cocks"

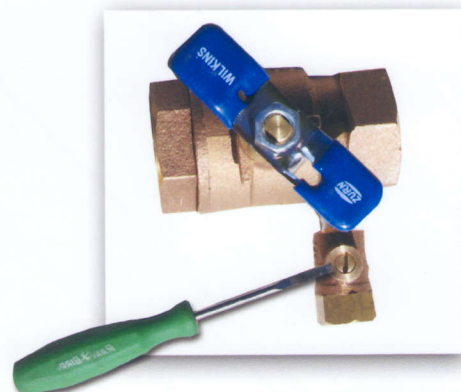

Step 3: Open all of the faucet drains in the manifold [generally 1 per group of valve boxes]. As well as any other faucets located along the outside plumbing.

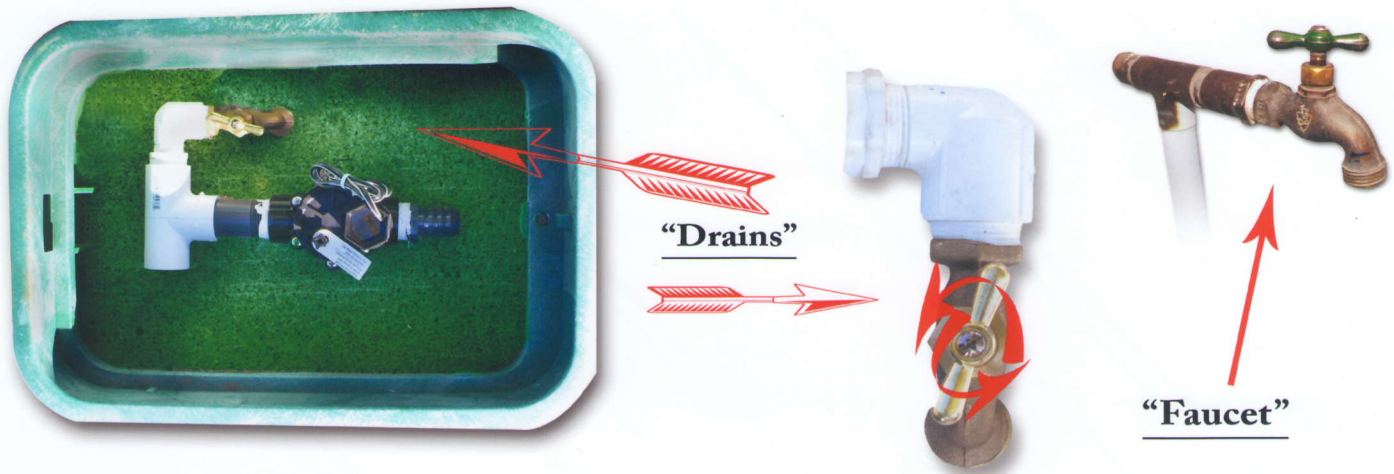

*** If your system has any drip filters in the manifold boxes, these should also be opened.**

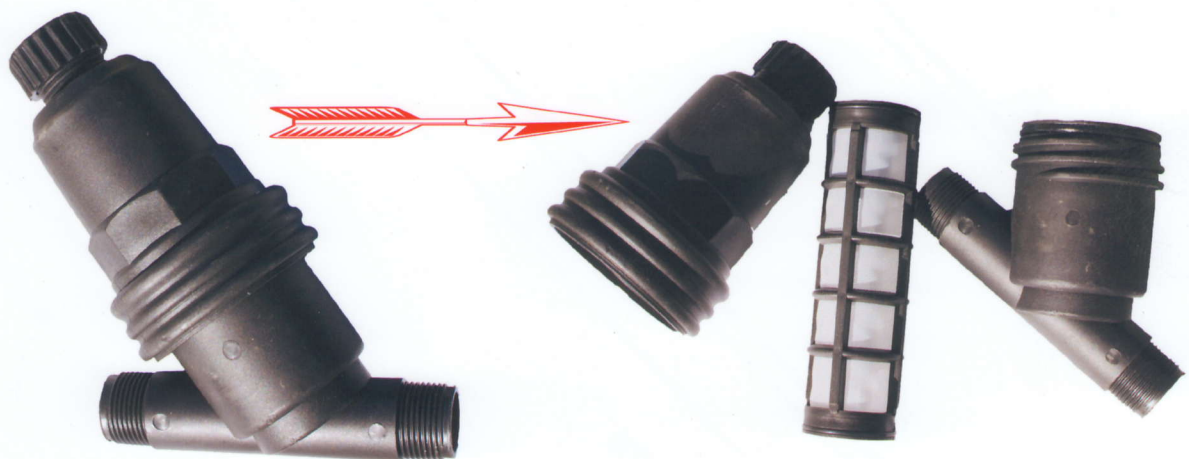

!! IMPORTANT !!

Don't forget to go back and open that cap on the drain port on the main shut off valve back in step one, if not all ready done.

Please turn your controller to off and leave plugged in whenever possible.

Thank you for choosing B & B Sprinklers. If you have any questions or need to schedule a service appointment please call our office @ [509] 466-7550.